


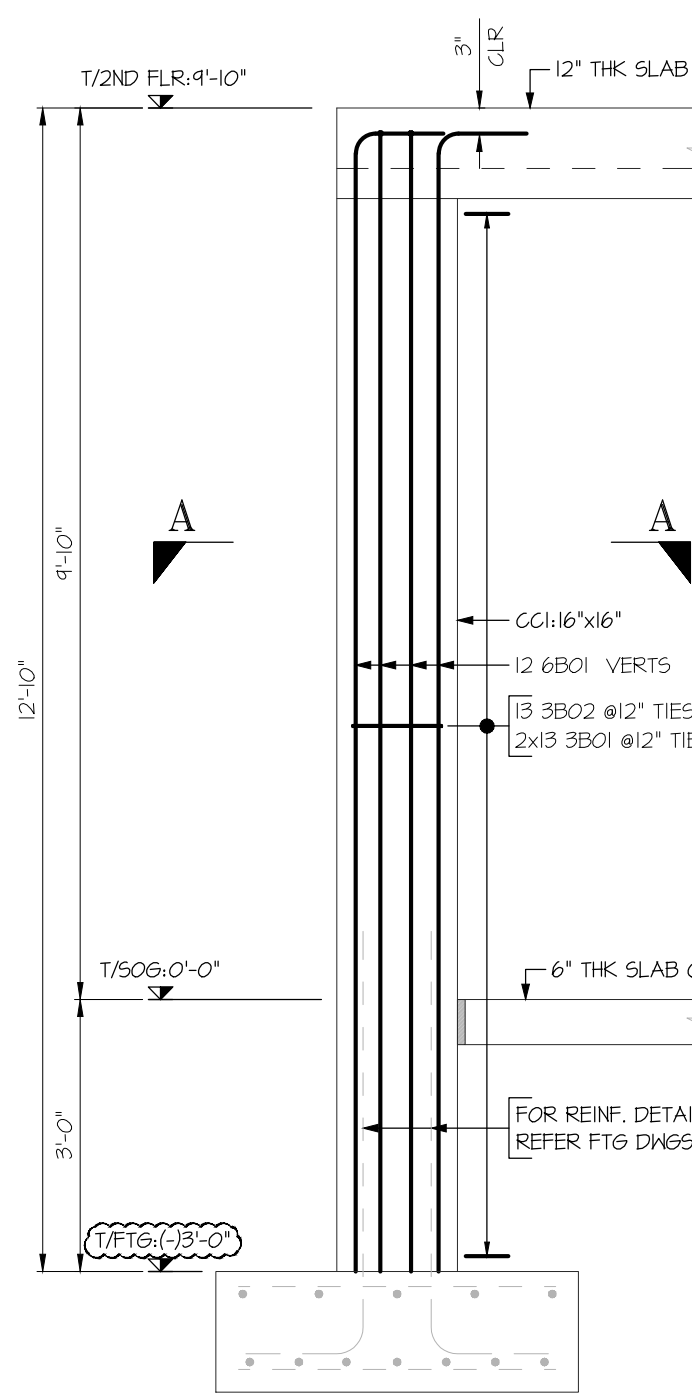
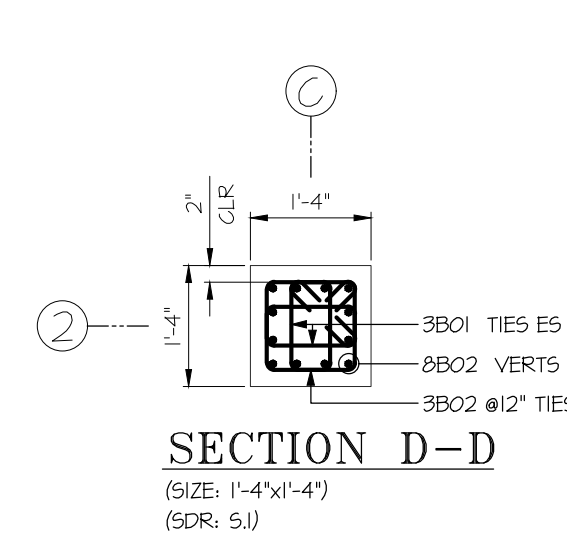
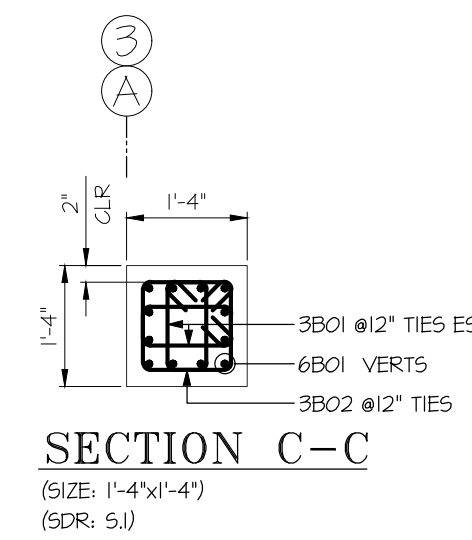
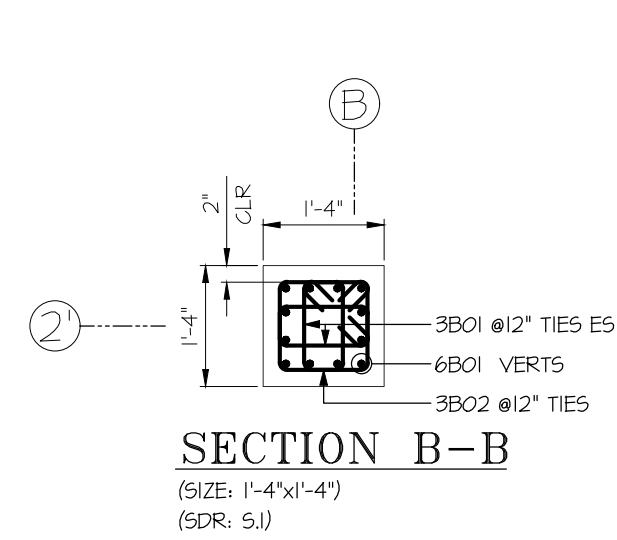
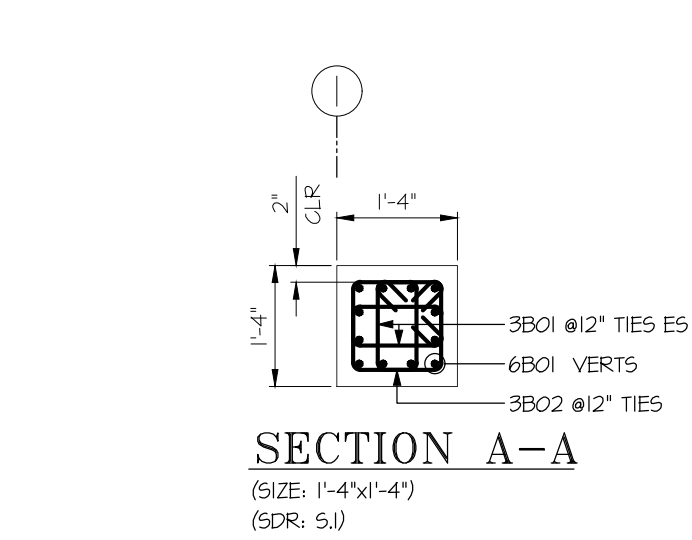
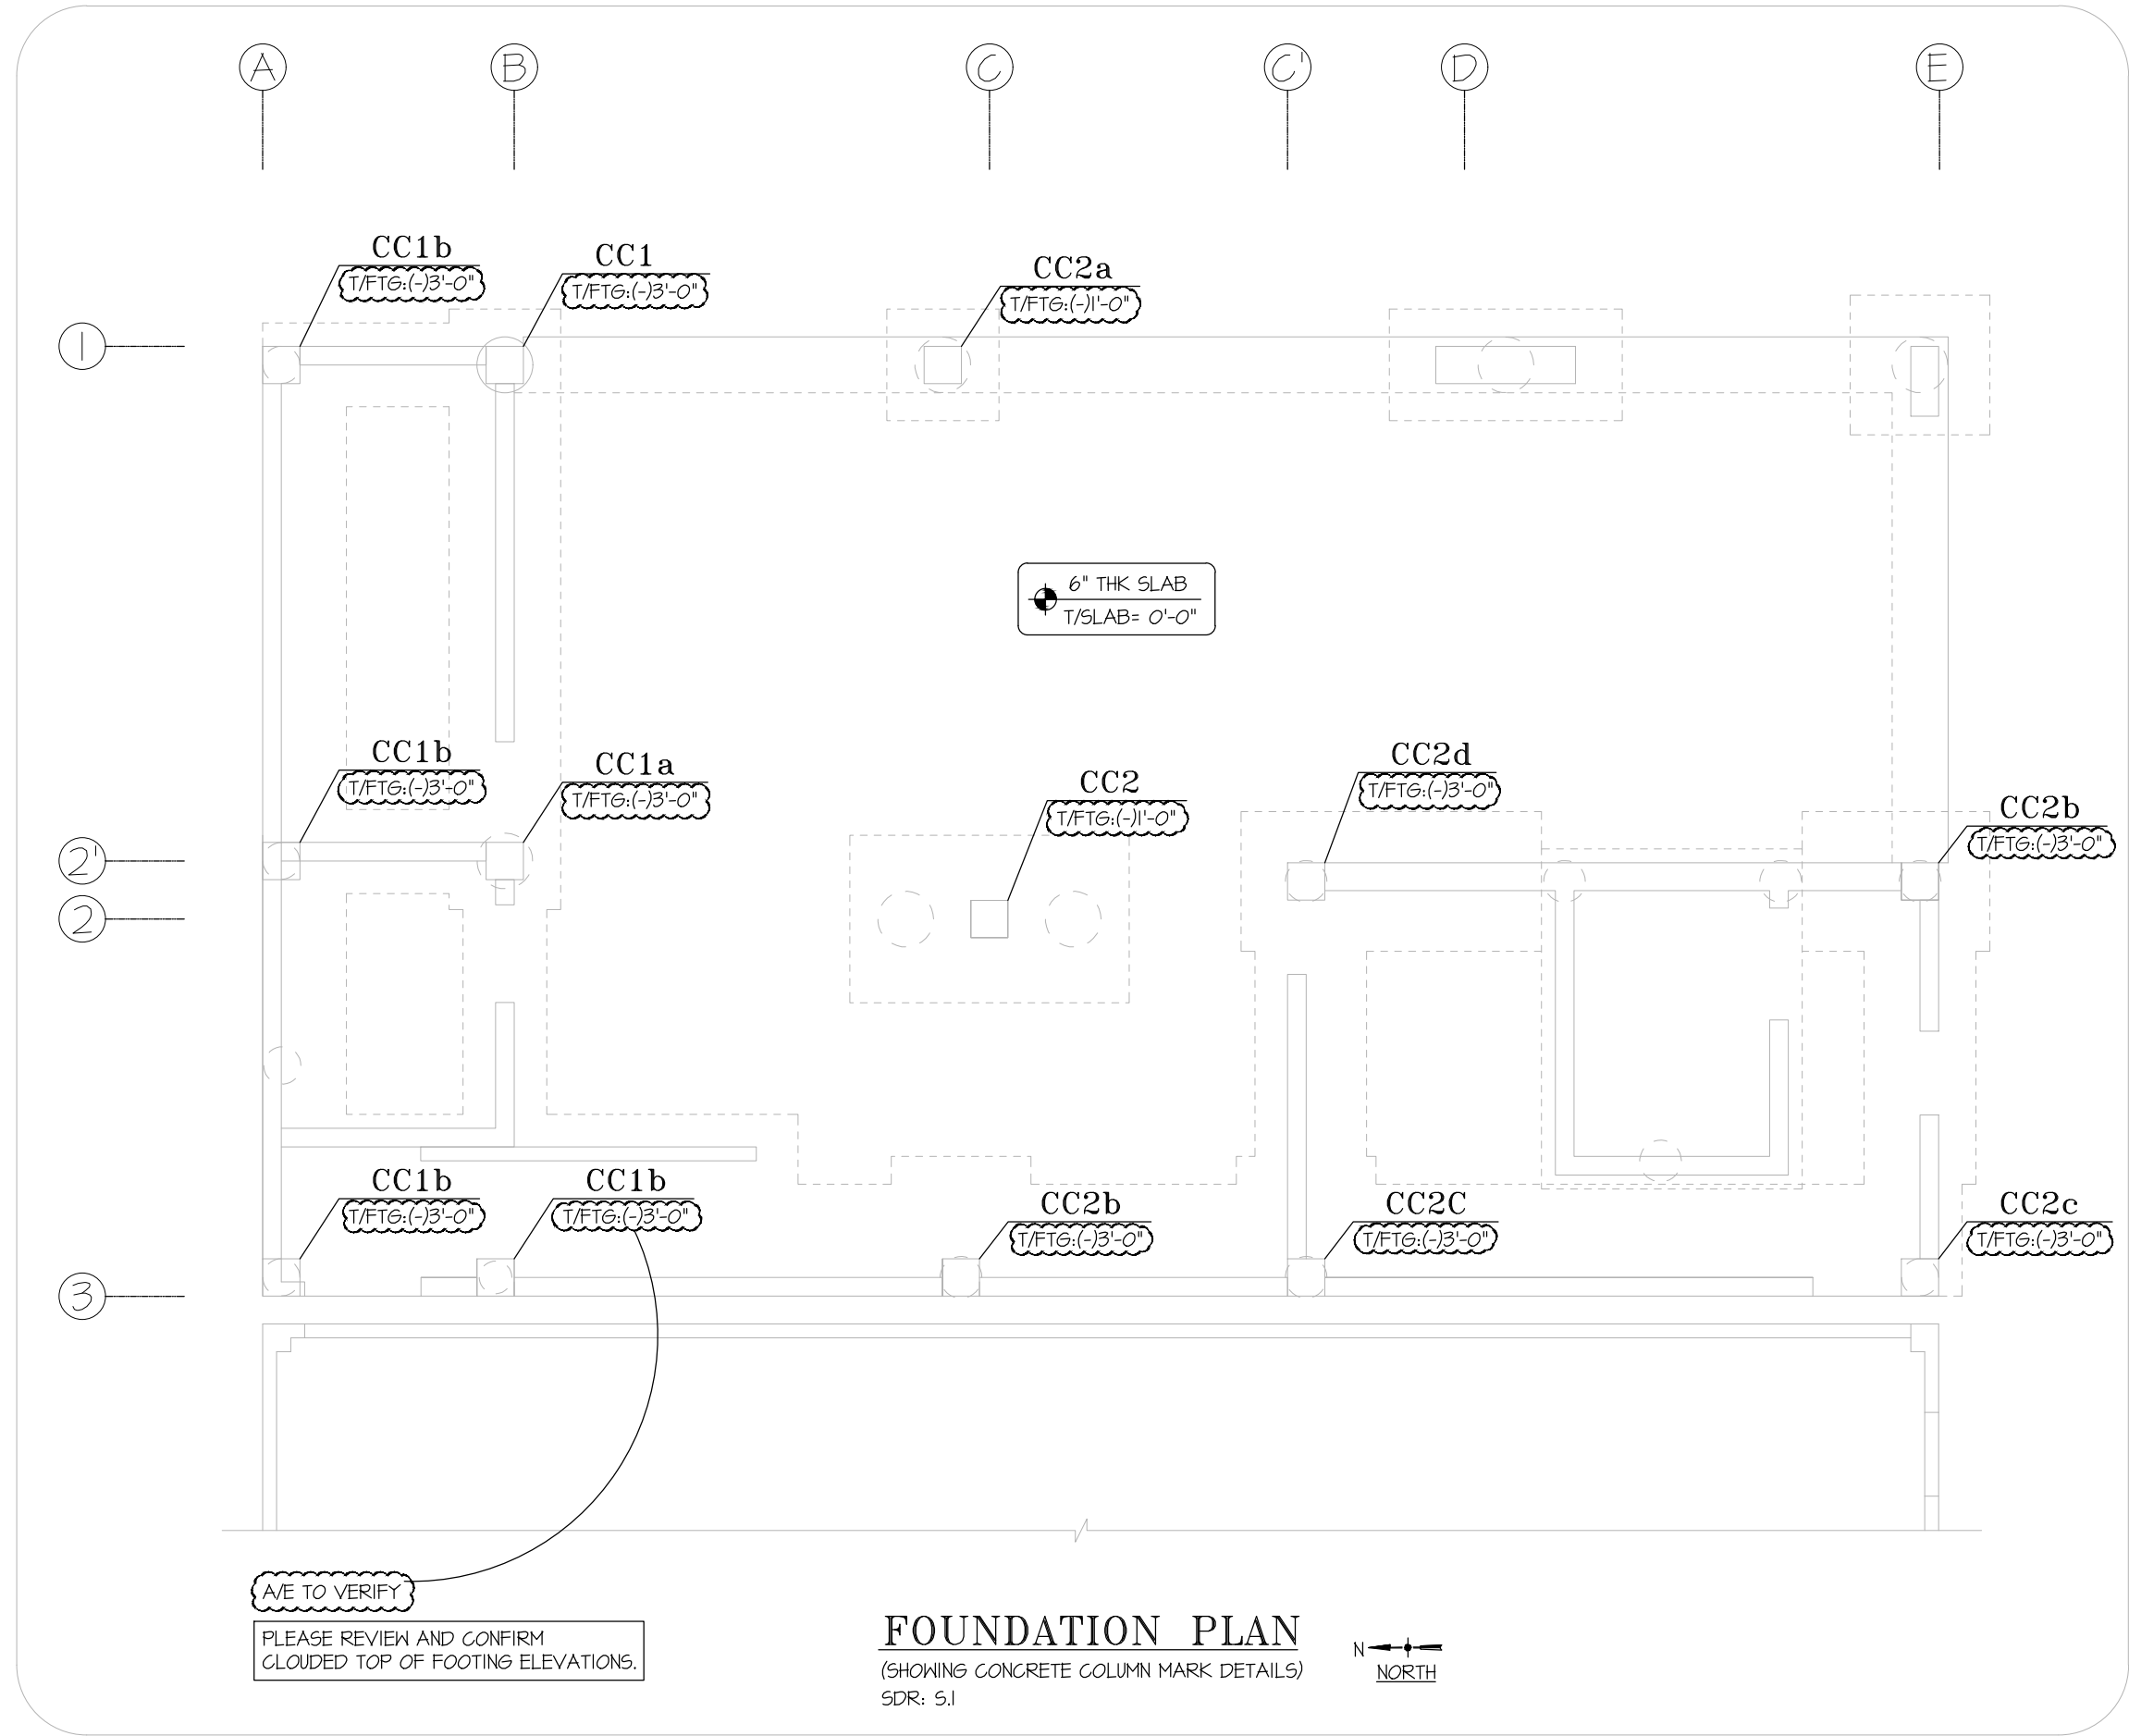
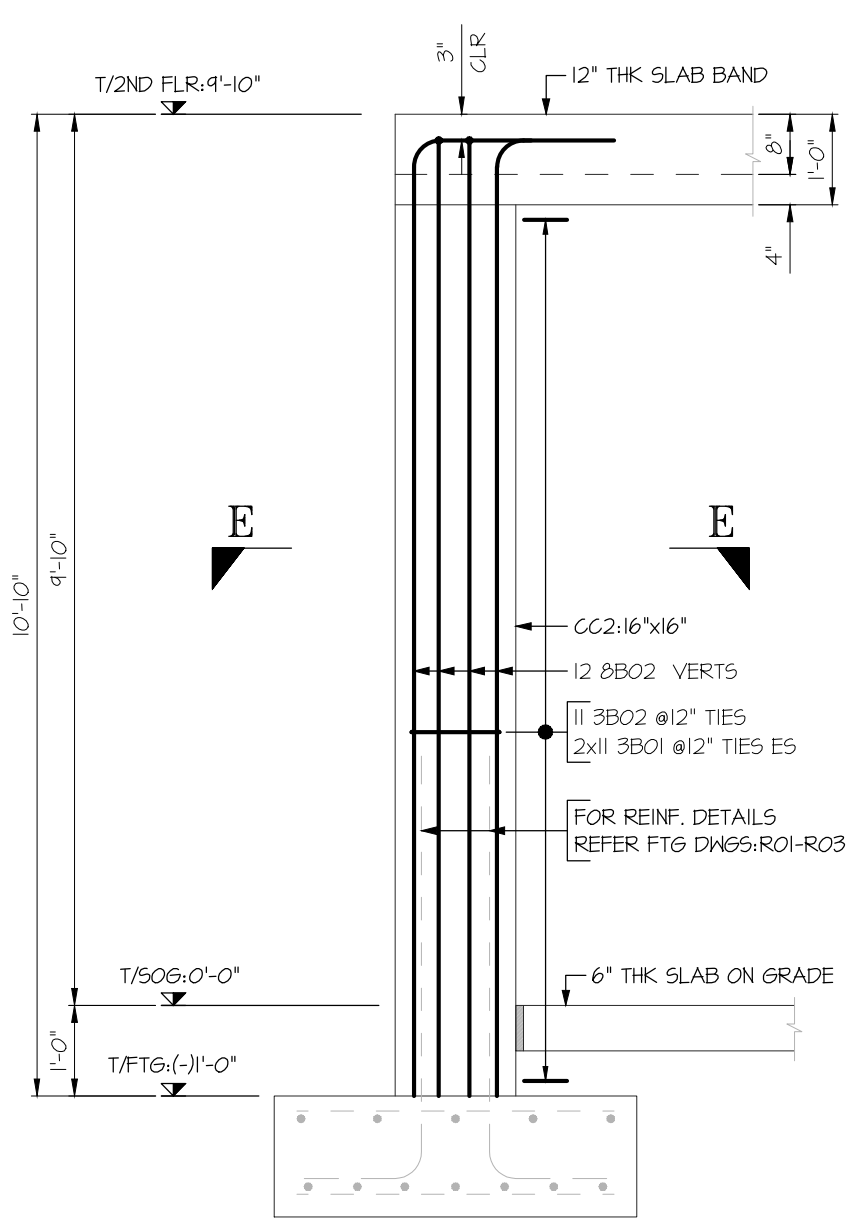
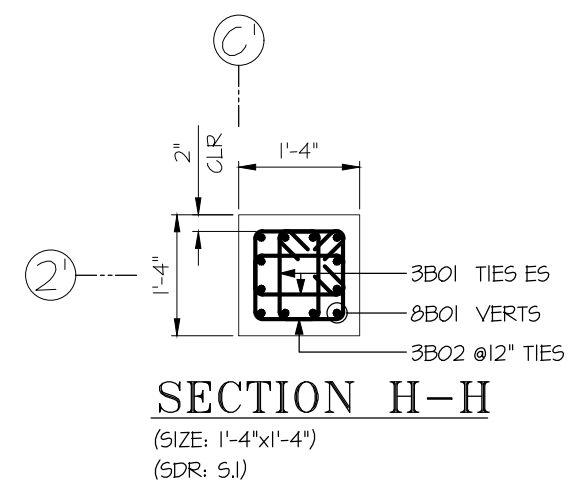
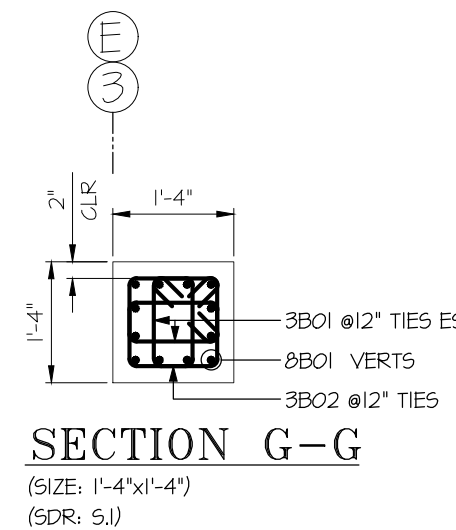
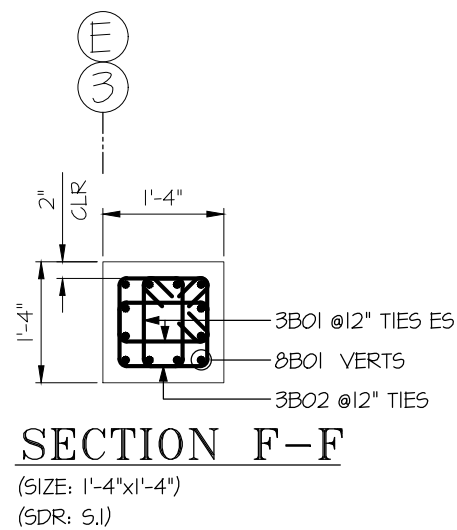
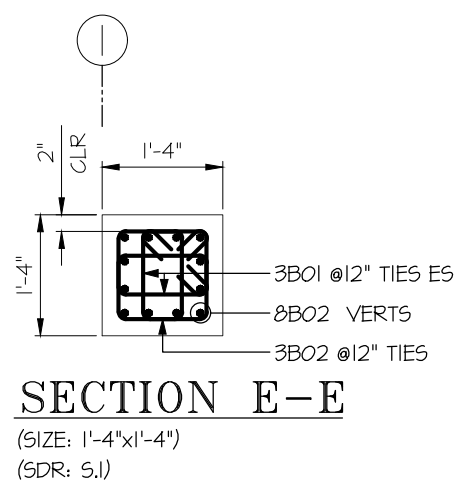
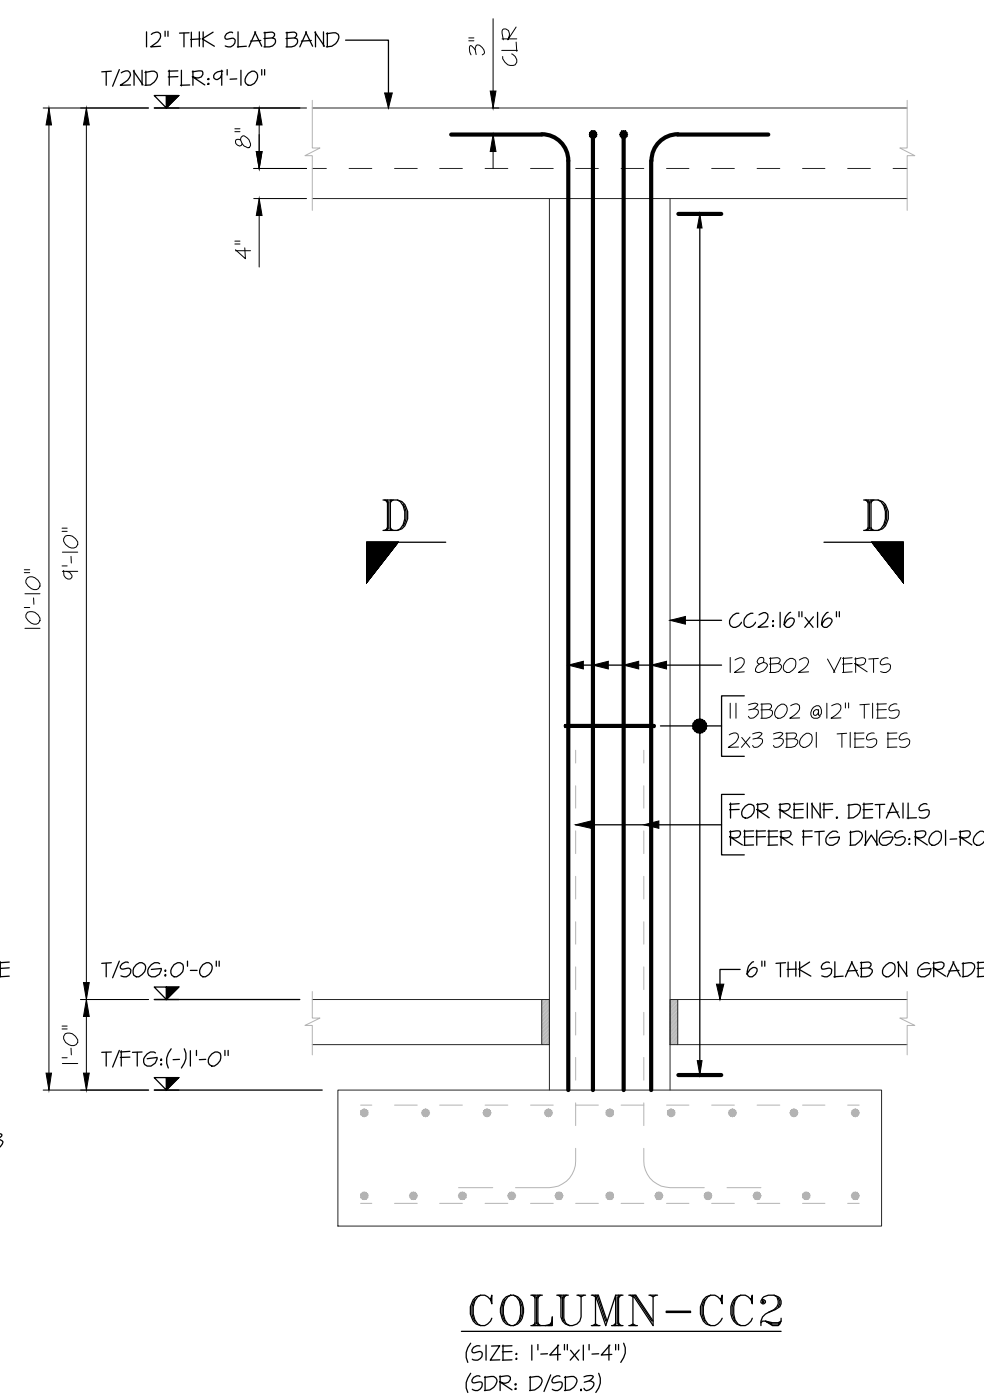
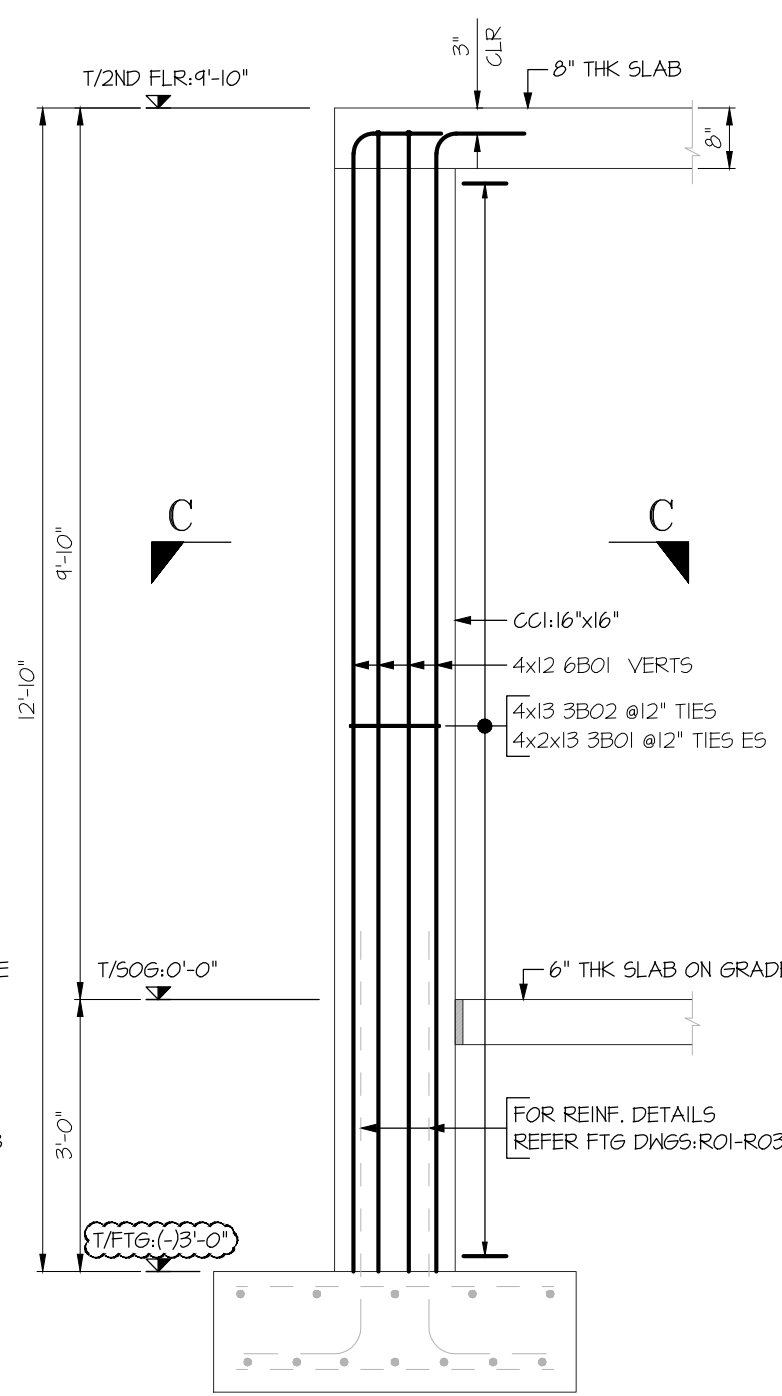
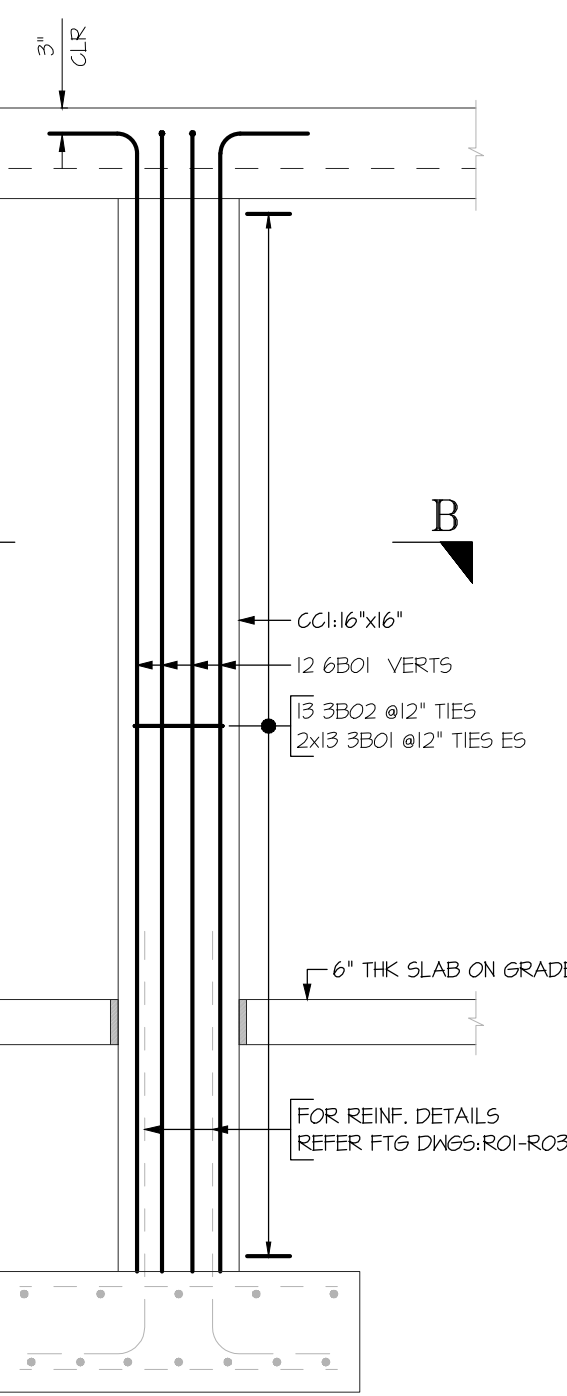


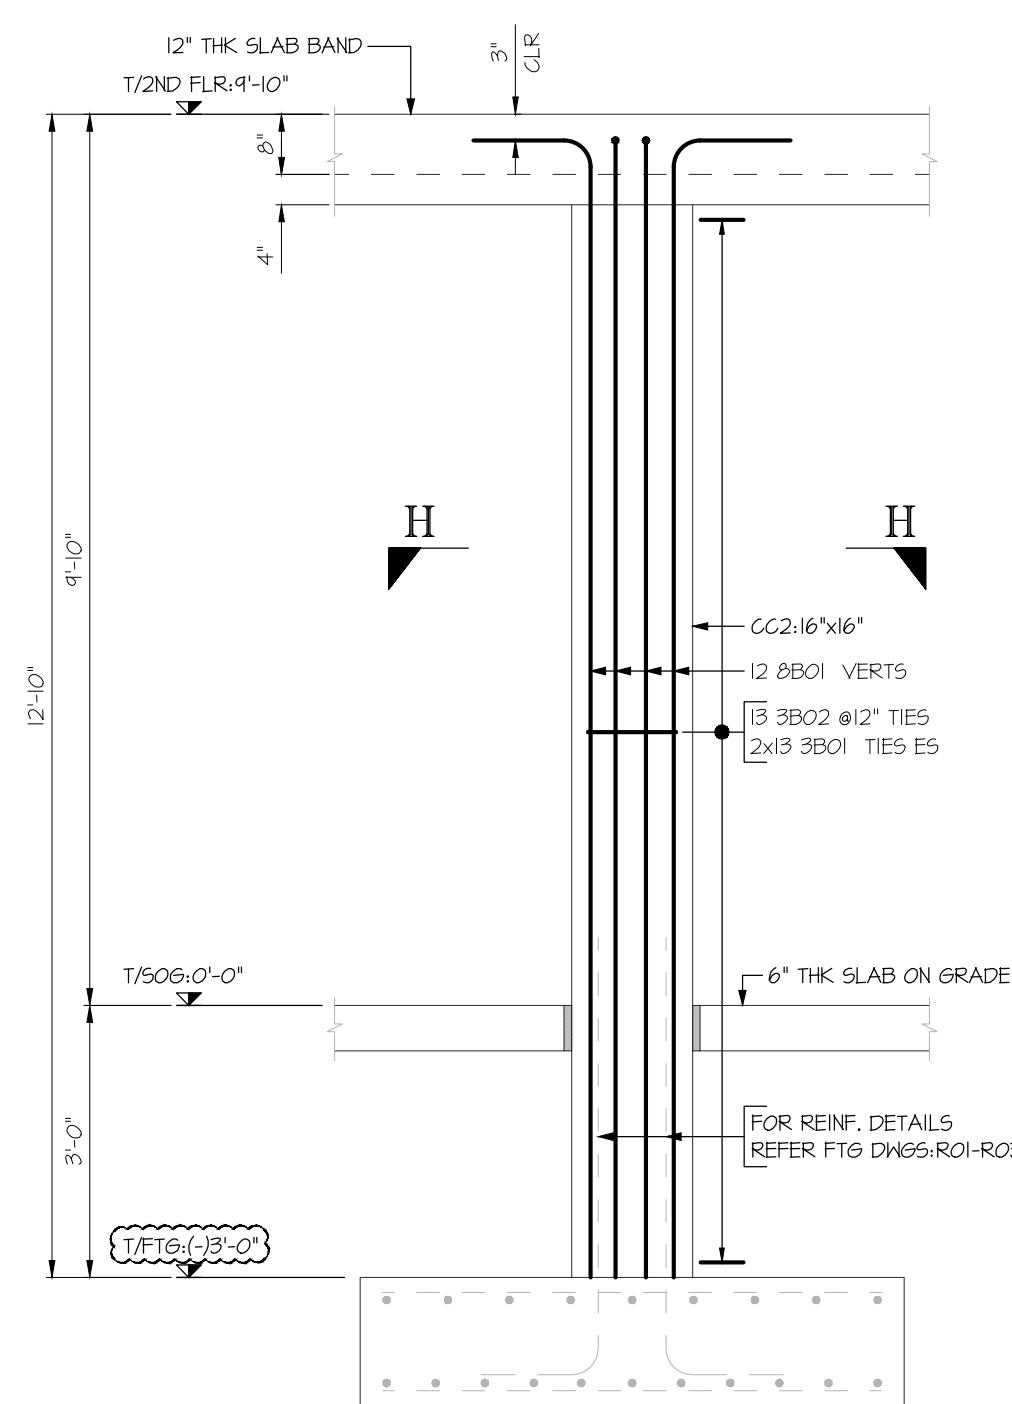


PLEASE REVIEW AND CONFIRM
CLOUDED TOP OF FOOTING ELEVATIONS.

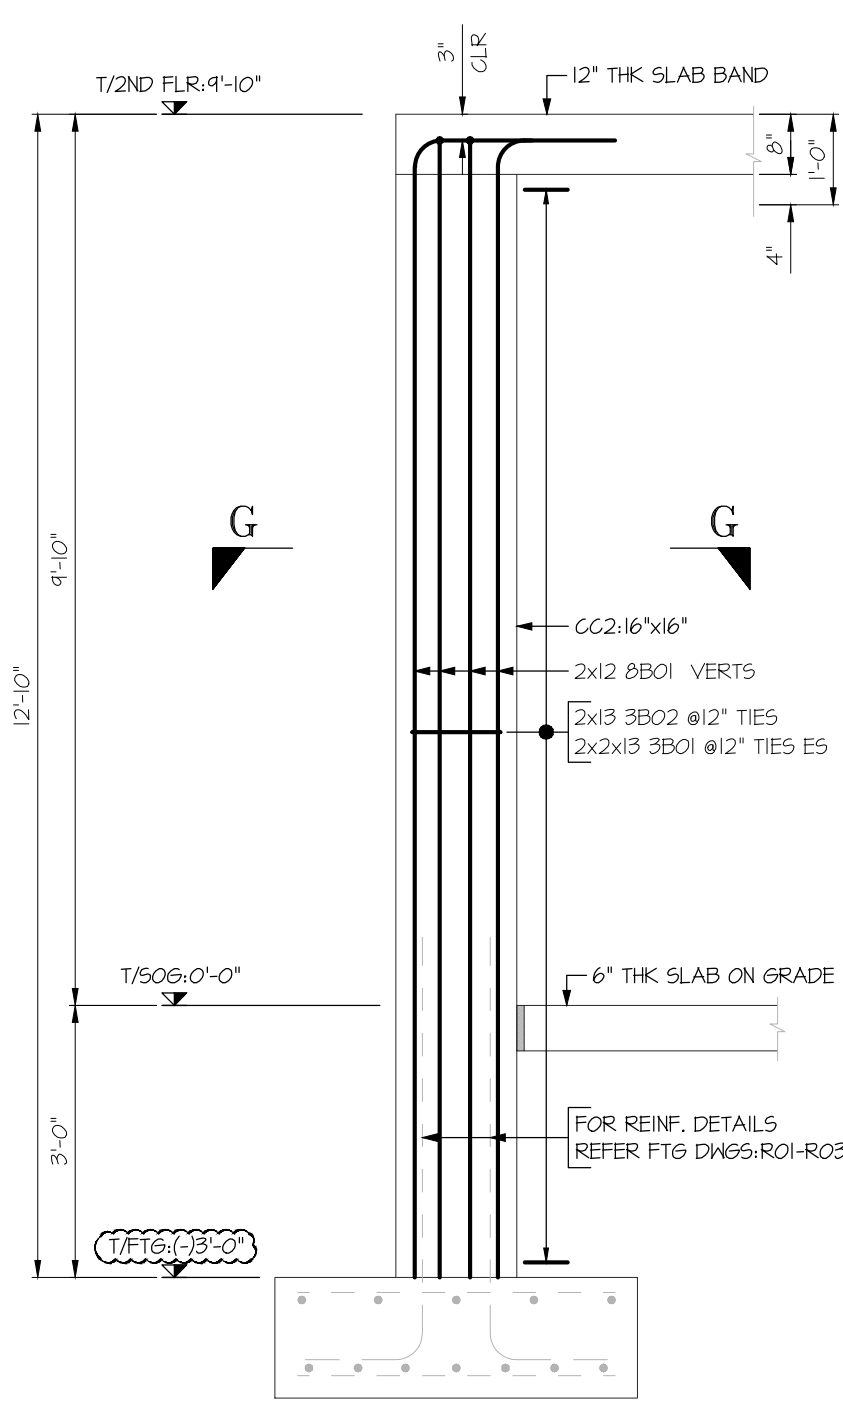

PLEASE REVIEW AND CONFIRM
CLOUDED TOP OF FOOTING ELEVATIONS.

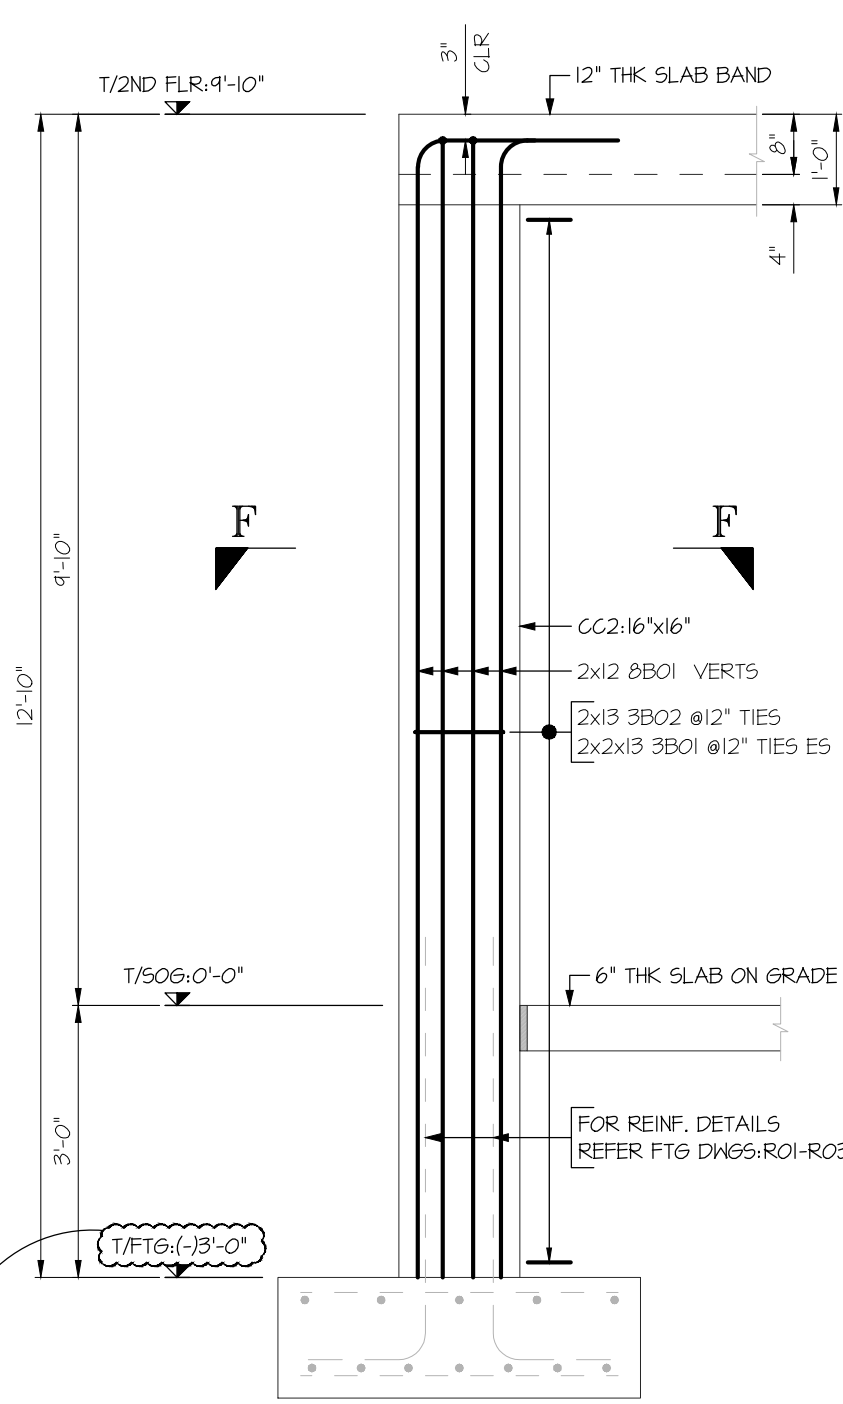

Release Number: COLUMNS (FIG-L2)				BAR LIST											
Bar Mark	Qty	Size	Total Length	Type	A'	B'	C'	D'	E'	F'	G'	H'	I'	J'	K'
3B01	314	#3	3'-7 3/4"	T1	0'-4 3/4"	1'-0"	0'-5 3/4"	1'-0"	0'-5 3/4"						
3B02	165	#3	4'-8 3/4"	T1	0'-4 3/4"	1'-0"	1'-0"	1'-0"	1'-0"	0'-4 3/4"					
6B01	72	#6	13'-7"	2	1'-0"	1'-0"									
8B01	60	#8	13'-11"	2	1'-4"	12'-7"									
8B02	24	#8	11'-11"	2	1'-4"	10'-7"									

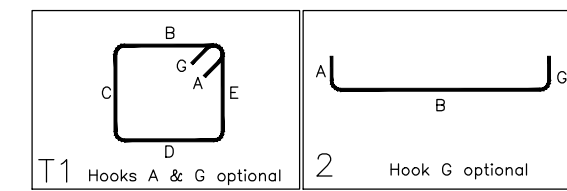

FOR COLUMNS		
LAP TABLE (10/SN.2) (3000 PSI-CLASS B)		
DIA	TOP	OTHERS
#3	28"	21"
#4	37"	28"
#5	47"	36"
#6	56"	43"
#7	82"	62"
#8	93"	71"